

- LEGEND**
- 1. FIRE ALARM CALL POINT
  - 2. FIRE ALARM CALL POINT (WITH GLASS)
  - 3. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 4. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 5. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 6. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 7. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 8. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 9. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 10. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 11. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 12. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 13. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 14. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 15. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 16. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 17. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 18. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 19. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 20. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 21. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 22. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 23. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 24. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 25. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 26. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 27. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 28. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 29. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 30. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 31. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 32. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 33. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 34. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 35. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 36. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 37. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 38. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 39. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 40. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 41. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 42. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 43. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 44. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 45. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 46. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 47. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 48. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 49. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 50. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 51. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 52. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 53. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 54. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 55. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 56. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 57. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 58. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 59. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 60. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 61. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 62. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 63. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 64. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 65. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 66. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 67. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 68. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 69. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 70. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 71. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 72. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 73. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 74. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 75. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 76. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 77. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 78. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 79. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 80. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 81. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 82. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 83. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 84. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 85. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 86. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 87. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 88. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 89. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 90. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 91. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 92. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 93. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 94. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 95. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 96. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 97. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 98. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 99. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS
  - 100. FIRE ALARM CALL POINT (WITH GLASS) - WITH GLASS

WORKS WILL BE CARRIED OUT IN ACCORDANCE WITH THE APPROVAL OF OPERATIONAL PLAN THROUGHOUT THE PUBLIC PARTS OF THE PREMISES.

MAXIMUM OCCUPANCY CAPACITY: BASEMENT TOILETS - 20 PEOPLE. GROUND LEVEL (EXTERNAL PATIO) - 26 PEOPLE.

**DRAWING REVISION / ISSUE STATUS**

No.	Date	By	Status
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			
21			
22			
23			
24			
25			
26			
27			
28			
29			
30			
31			
32			
33			
34			
35			
36			
37			
38			
39			
40			
41			
42			
43			
44			
45			
46			
47			
48			
49			
50			
51			
52			
53			
54			
55			
56			
57			
58			
59			
60			
61			
62			
63			
64			
65			
66			
67			
68			
69			
70			
71			
72			
73			
74			
75			
76			
77			
78			
79			
80			
81			
82			
83			
84			
85			
86			
87			
88			
89			
90			
91			
92			
93			
94			
95			
96			
97			
98			
99			
100			

**DO NOT SCALE FROM DRAWING. ALL DIMENSIONS TO BE TAKEN & VERIFIED ON SITE BY CONTRACTOR. ANY DIMENSIONS NOTIFIED TO THE CONTRACT ADMINISTRATOR IMMEDIATELY. THIS DRAWING IS THE PROPERTY OF LIVING VENTURES RESTAURANTS Ltd**

**SCALE 1:1**

1:100 = 1mm = 100mm  
 1:200 = 1mm = 200mm  
 1:500 = 1mm = 500mm  
 1:1000 = 1mm = 1000mm

**APPROVED FOR CONSTRUCTION**

DATE: 10/05/2014  
 DRAWN BY: [Name]  
 CHECKED BY: [Name]  
 APPROVED BY: [Name]

**BOTHWELL STREET**

14-16 BOTHWELL STREET  
 GLASGOW


**BASEMENT LICENSING**


14-16 BOTHWELL STREET  
 GLASGOW

**STATUS**

DATE: 10/05/2014  
 DRAWN BY: [Name]  
 CHECKED BY: [Name]  
 APPROVED BY: [Name]

**14-16 BOTHWELL STREET  
GLASGOW**



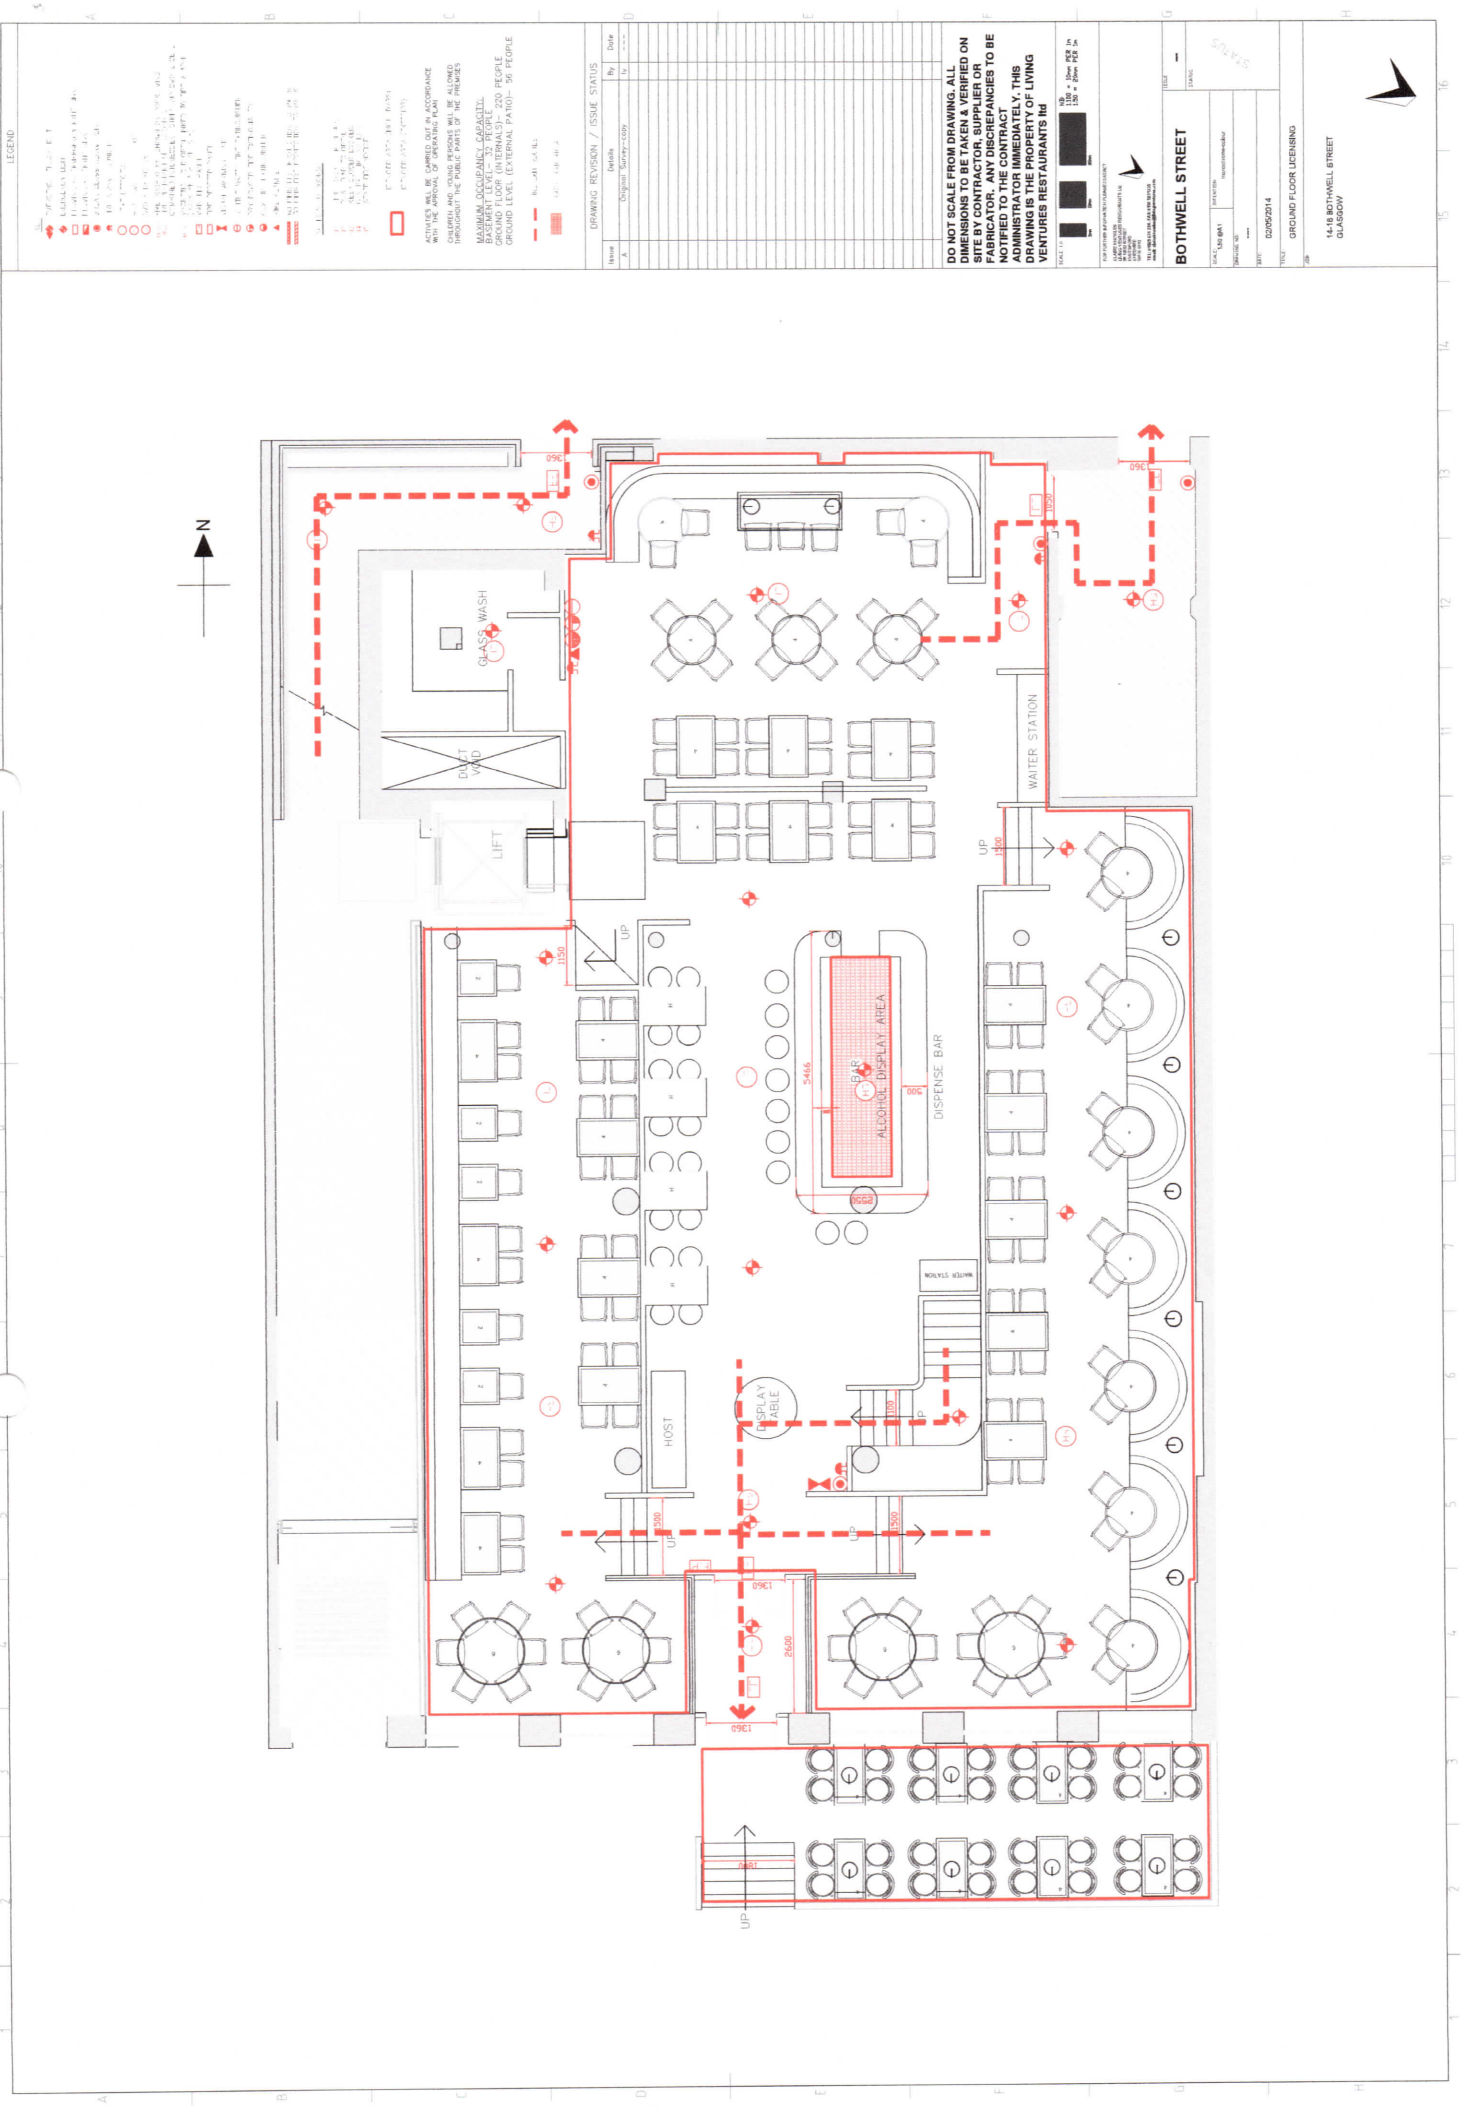

- LEGEND**
- EXISTING STRUCTURE
  - PROPOSED STRUCTURE
  - FIRE ALARM CALL POINT
  - FIRE ALARM CALL POINT WITH CALL NUMBER
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION AND FLOOR LEVEL
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION AND FLOOR LEVEL AND FIRE RISK LEVEL
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION AND FLOOR LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION AND FLOOR LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION AND FLOOR LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL
- ACTIVITIES TO BE CARRIED OUT IN ACCORDANCE WITH THE APPROVAL OF OPERATING PLAN**
- FIRE ALARM CALL POINT
  - FIRE ALARM CALL POINT WITH CALL NUMBER
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION AND FLOOR LEVEL
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION AND FLOOR LEVEL AND FIRE RISK LEVEL
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION AND FLOOR LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION AND FLOOR LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL
  - FIRE ALARM CALL POINT WITH CALL NUMBER AND LOCATION AND FLOOR LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL AND FIRE RISK LEVEL
- MAXIMUM OCCUPANCY: 200 PEOPLE  
BASEMENT FLOOR: 200 PEOPLE  
GROUND FLOOR (INTERNAL): 200 PEOPLE  
GROUND LEVEL (EXTERNAL): 50 PEOPLE**

DRAWING REVISION / ISSUE STATUS		By	Date
No.	Details		
1	Original Survey-copy		

**DO NOT SCALE FROM DRAWING. ALL DIMENSIONS TO BE TAKEN & VERIFIED ON SITE BY CONTRACTOR, SUPPLIER OR FABRICATOR. ANY DISCREPANCIES TO BE NOTIFIED TO THE CONTRACTOR IMMEDIATELY. THIS DRAWING IS THE PROPERTY OF LIVING VENTURES RESTAURANTS IN**

SCALE 1:50

DATE 11/01/2014

PROJECT NO. 1418

PROJECT NAME: 1418 BOTHWELL STREET

CLIENT: VENTURES RESTAURANTS IN

DESIGNER: LIVING VENTURES RESTAURANTS IN

ARCHITECT: LIVING VENTURES RESTAURANTS IN

ENGINEER: LIVING VENTURES RESTAURANTS IN

PROJECT MANAGER: LIVING VENTURES RESTAURANTS IN

**BOTHWELL STREET**

1418 BOTHWELL STREET

GLASGOW

GROUND FLOOR LICENSING

1418 BOTHWELL STREET

GLASGOW